

INSTALLATION INFORMATION



GO PUMP – SPEC. 1000

CAUTION: Dispensers must be installed with a suitable power-operated pump incorporating a provision for expansion relief which will relieve at pressures not to exceed 50 lbs. per sq. inch. Do not use line check valve between dispenser and power-operated pump unless provided with relief valve. (Remote dispensers only.)

All threaded pipe joints of liquid handling piping must be assembled with Underwriters listed gasoline resistant pipe joint sealing compound. Apply on male threads only.

Note: Installation to conform to National, State, & Local Codes.

Note: Impact Safety Valves are to be installed with shear section in line with surface of island within + or - 3/4 inch. Depending on valve to be used, a longer or shorter inlet nipple may be required.

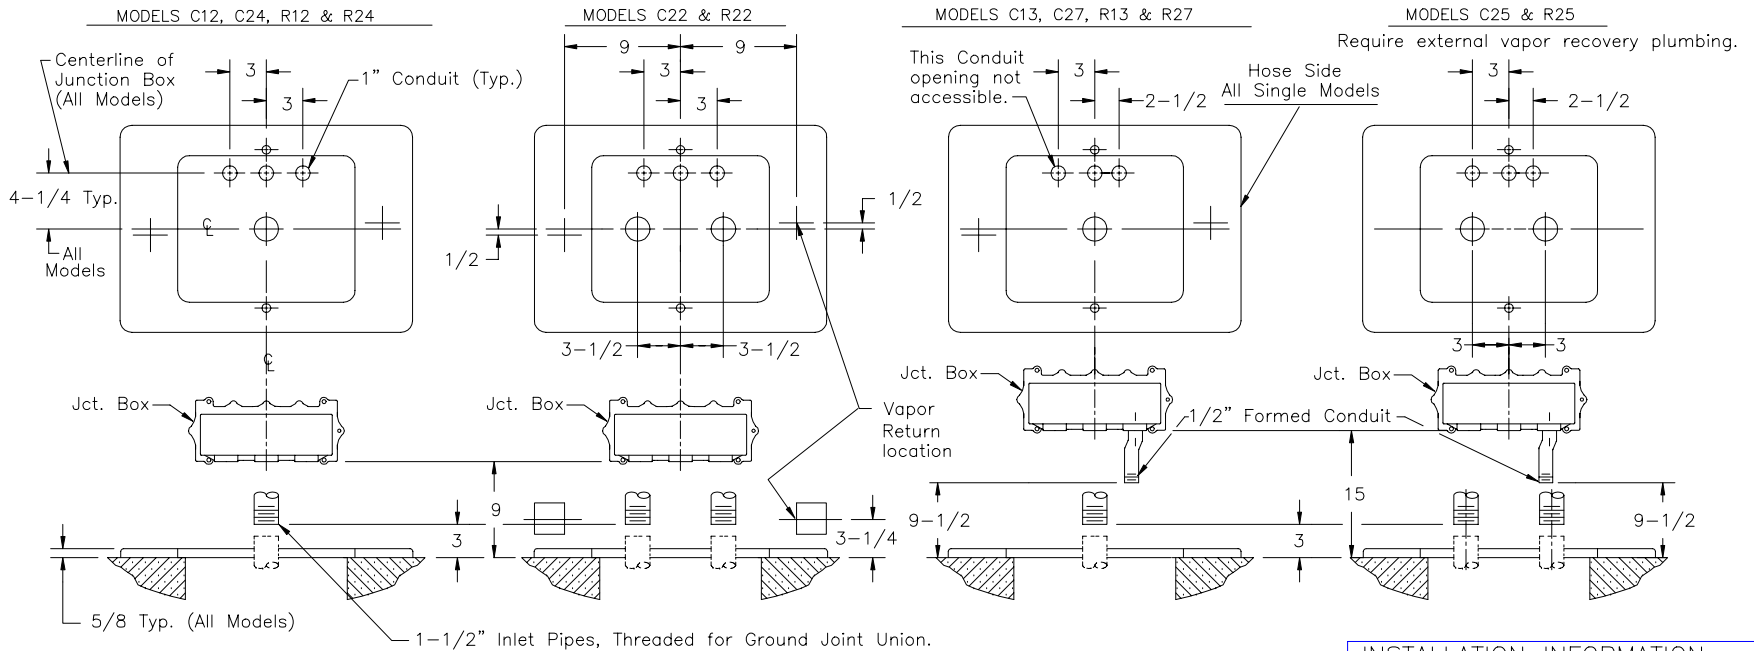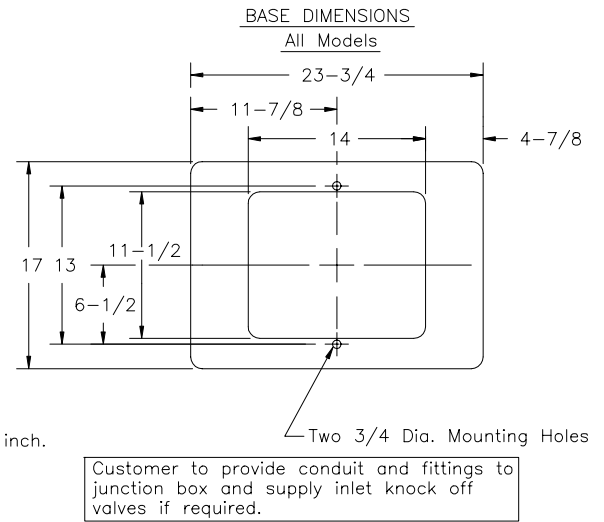

INSTALLATION INFORMATION

GO PUMP

BENNETT®
Spring Lake Michigan, 49456

P-0028
REV.D 7/03

1
SHEET